

7.4.3 สถานพยาบาลมีการตรวจสอบระบบเสียงประกาศให้สามารถใช้งานได้อย่างต่อเนื่อง

- มีการตรวจสอบระบบเสียงประกาศ ระบบใช้งานได้ครบถ้วน


(1) มี Check list การตรวจสอบระบบและมีการบันทึกเก็บไว้เป็นประวัติการตรวจสอบ

- ที่เป็นเอกสาร

ตารางตรวจสอบระบบเสียงประกาศ

จุดติดตั้ง	ปัญหาที่พบ	วันที่พบ	วันที่แก้ไข	แนวทางแก้ไข	หมายเหตุ
ถนนรอบโรงพยาบาล	ลำโพงขาด ไม่ดัง	10/3/2568	10/8/2568	ส่งซ่อมบริษัท	
บ้านพักเจ้าหน้าที่	-				
ตึกปฐมสุข	-				
ตึกผู้ป่วยใน	-				
ตึกทันตกรรม-กายภาพ	-				
ตึกผู้ป่วยนอก	-				
ทั้งระบบ	server ฮาร์ดแวร์อัตโนมัติ เสียงตามสายไม่ดังทั้งโรงพยาบาล	10/10/2568	10/10/2568	login เข้า server ใหม่	

- ตรวจสอบอัตโนมัติ

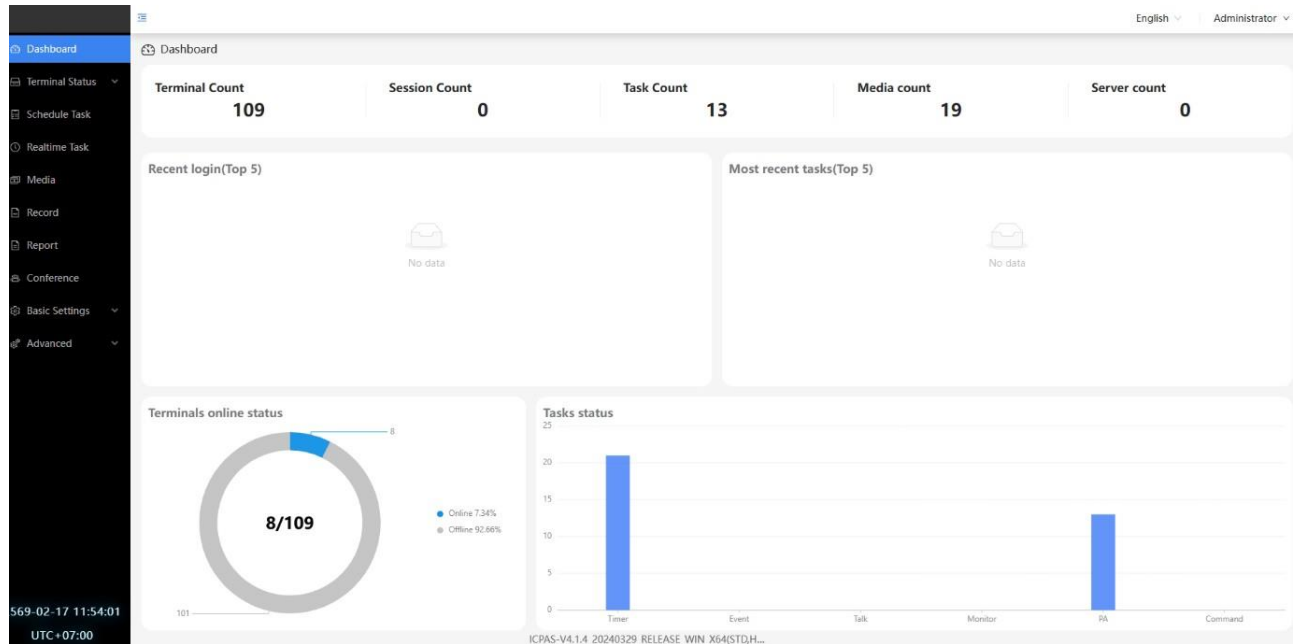

English Administrator

Dashboard

Terminal Status

Table View

Grid View

Schedule Task

Realtime Task

Media

Record

Report

Conference

Basic Settings

Advanced

Zone

Online 8

Offline 101

All 109

In task 0

Online panel 0

PIN 0

Dante 0

Please input number...

State	ID	Agreement	Name	Local IP	Task	Audio Processing	Handle
Idle	150	NAS	SP_HALL_FLAT	192.168.14.150:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	151	NAS	SP_HALL_FRONTROAD	192.168.14.151:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	152	NAS	AMP_ZONE1_FCU	192.168.14.152:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	153	NAS	SP_HALL_DOME	192.168.14.153:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	154	NAS	AMP_ZONE2_OPD	192.168.14.154:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	155	NAS	AMP_ZONE3_SUPPLY	192.168.14.155:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	156	NAS	SP_HALL_SUPPLY	192.168.14.156:2046	Idle	Tuning parameter	Talk Monitor PA Restart
Idle	239	XC	239	192.168.14.239:5060	Idle	Tuning parameter	Talk Monitor PA Restart

(1) มีระบบไฟฟ้าสำรอง UPS และเครื่องกำเนิดไฟฟ้า

